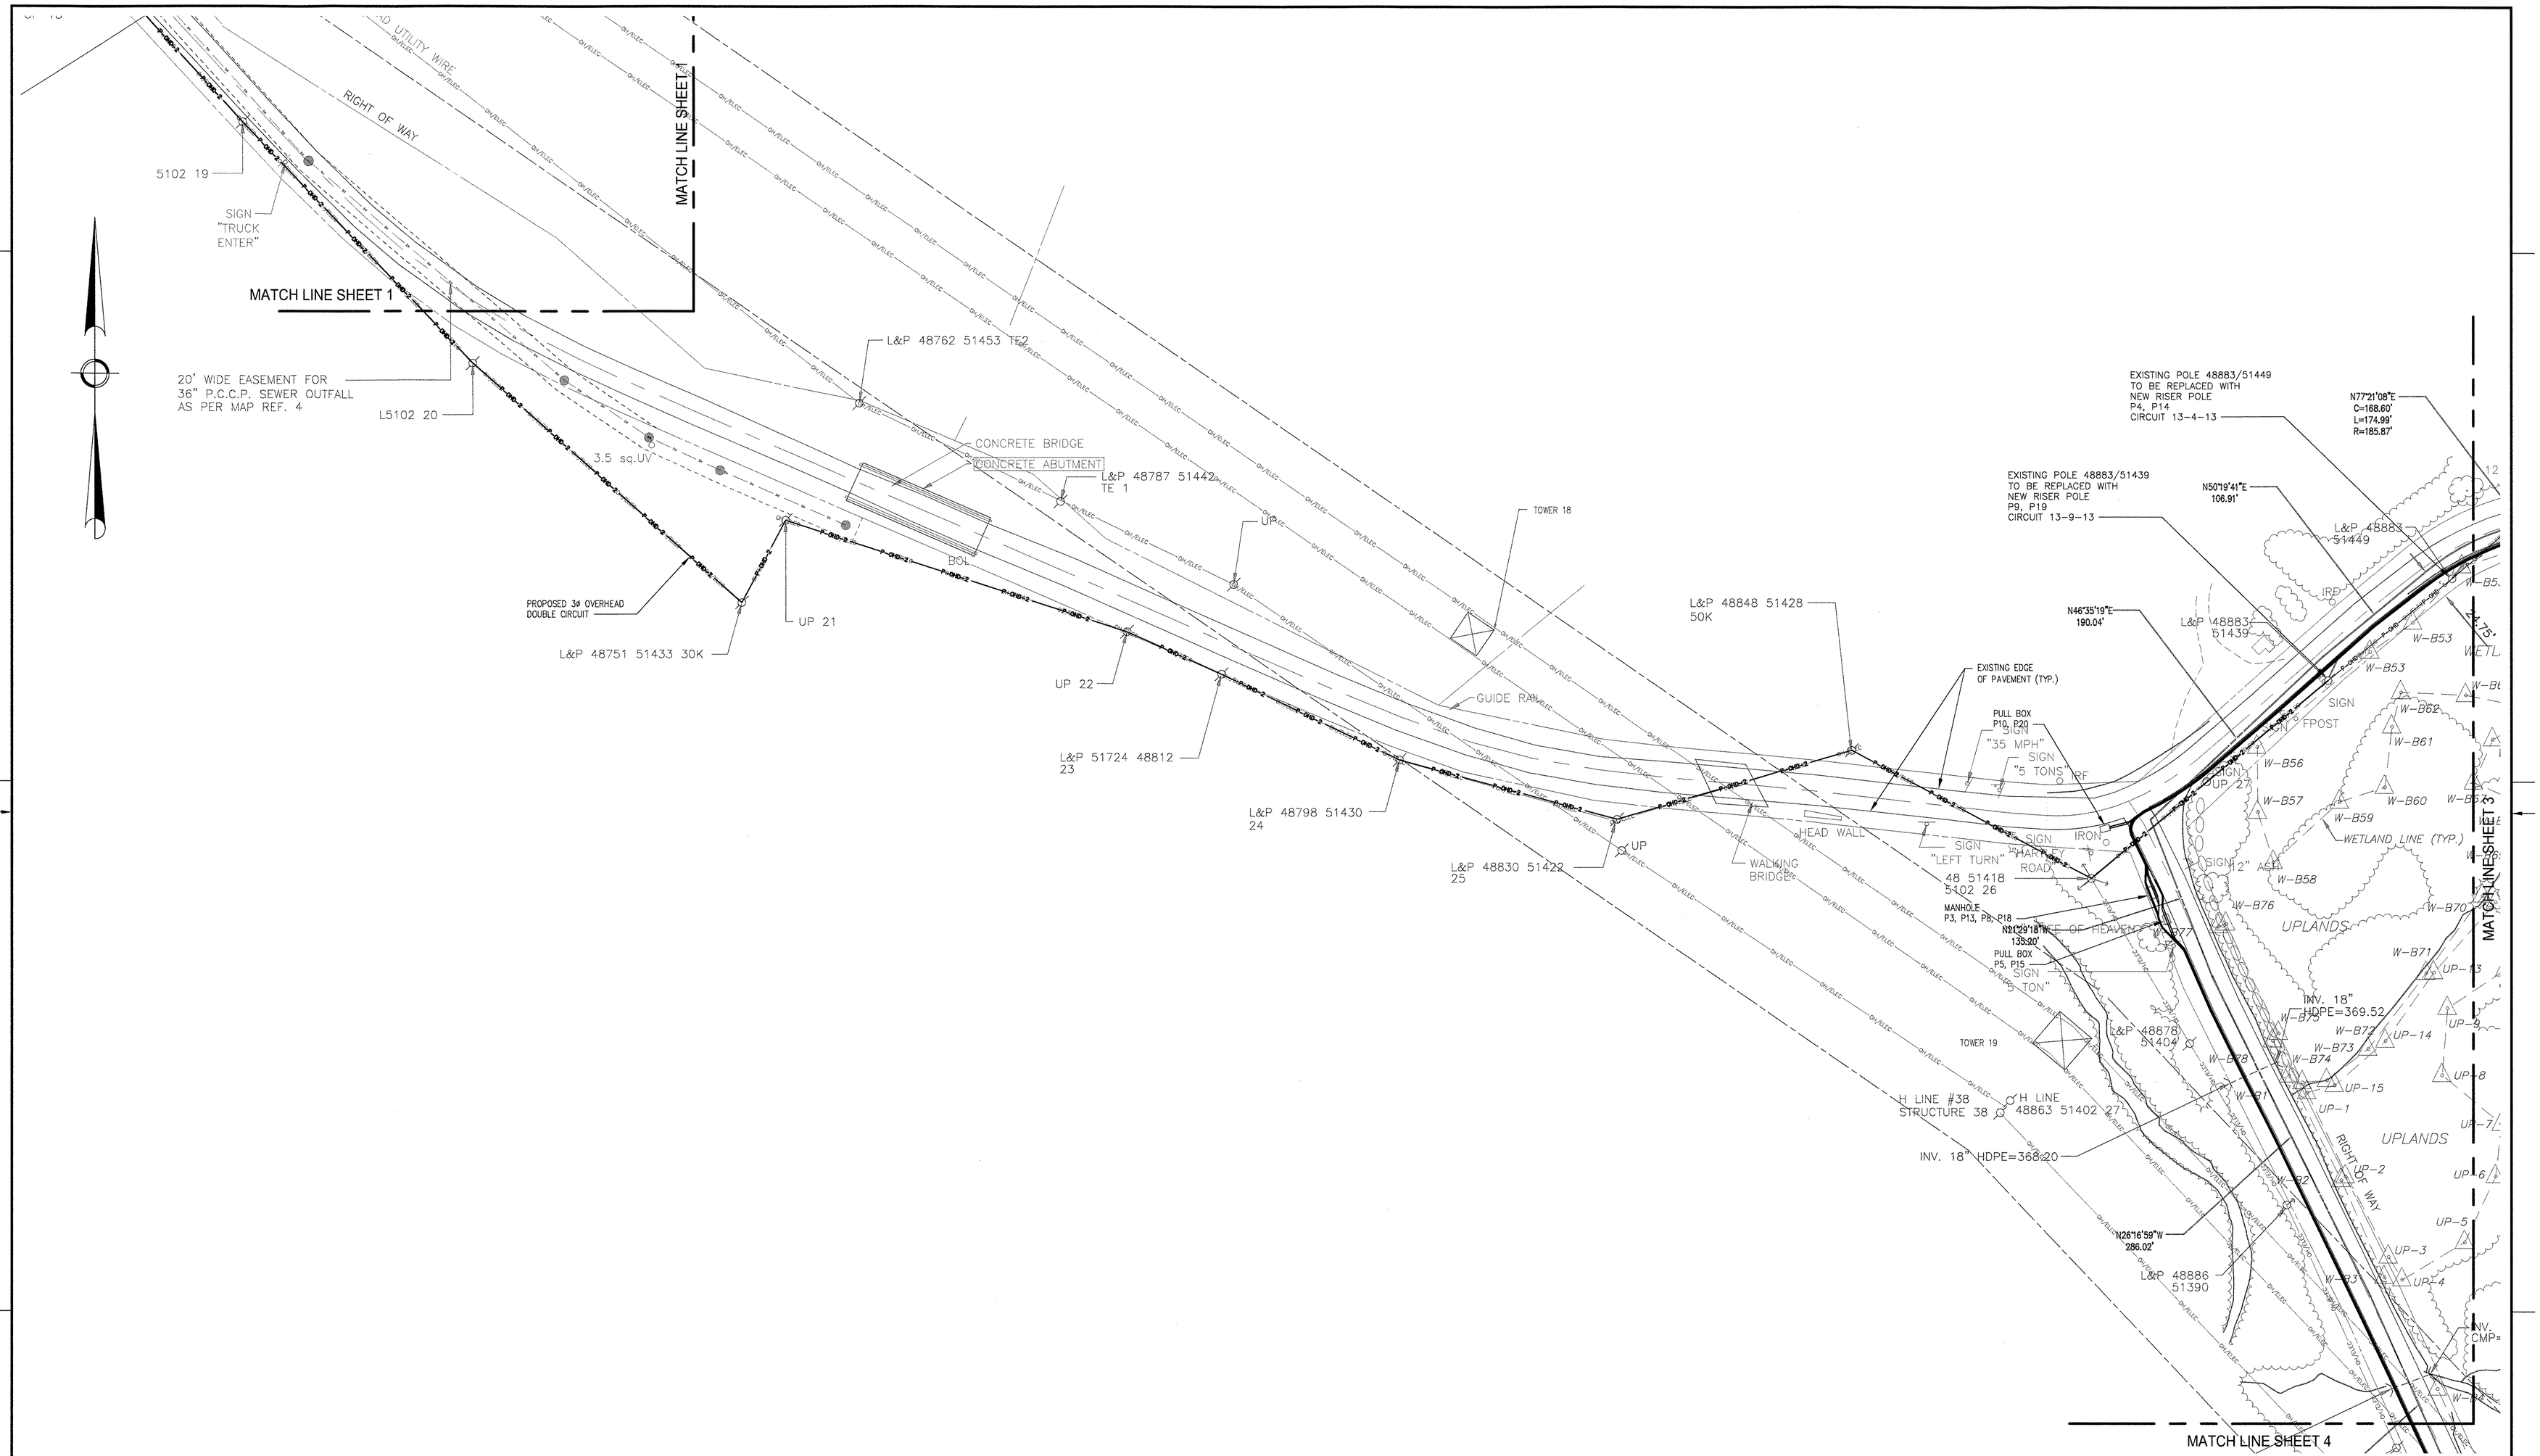

LEGEND

P-OHD — P-OHD	PROPOSED SINGLE CIRCUIT OVERHEAD DISTRIBUTION WIRE
P-OHD-2	PROPOSED DOUBLE CIRCUIT OVERHEAD DISTRIBUTION WIRES
UD — UD	PROPOSED UNDERGROUND DISTRIBUTION CONDUITS
	PROPOSED UTILITY POLE
OH/ELEC — OH/ELEC	EXISTING OVERHEAD ELECTRIC

ARCH 0 1 2 3
ENGRG 0 1 2 3

REV	REVISION	DWN	DES	CHKD	DATE

ORANGE AND ROCKLAND UTILITIES, INC.
PEARL RIVER NEW YORK

ENGINEERING REVIEW		
DEPT.	SIGNATURE	DATE
CIVIL/SURVEY		
TELECOM/MET.		
TRANS & SUB.		
RELAY		
DISTRIBUTION	[signature]	5-2-12
DWN J.M.	DES	CHKD
DESIGN REVIEW	[signature]	DATE 5/2/12

APPROVED [signature]
DATE 5-2-12
☒ PERMIT
☐ BID
☐ CONSTRUCTION
☐ RECORD
☐ _____

HARTLEY ROAD SUBSTATION

UNDERGROUND / OVERHEAD DISTRIBUTION IMPROVEMENTS SHEET 2

SCALE	STATION NO.	DRAWING NUMBER			SHEET	REV.
1" = 50'	0013	K	F	6500	3 OF 5	A

I:\Tedd_WORK\REQ\CIVIL\Hartley\06017C\Hartley Road Substation -At Turi Site - TB JVI_Environmental Package Drawings\6500.dwg, 5/2/2012 2: 05:43 PM