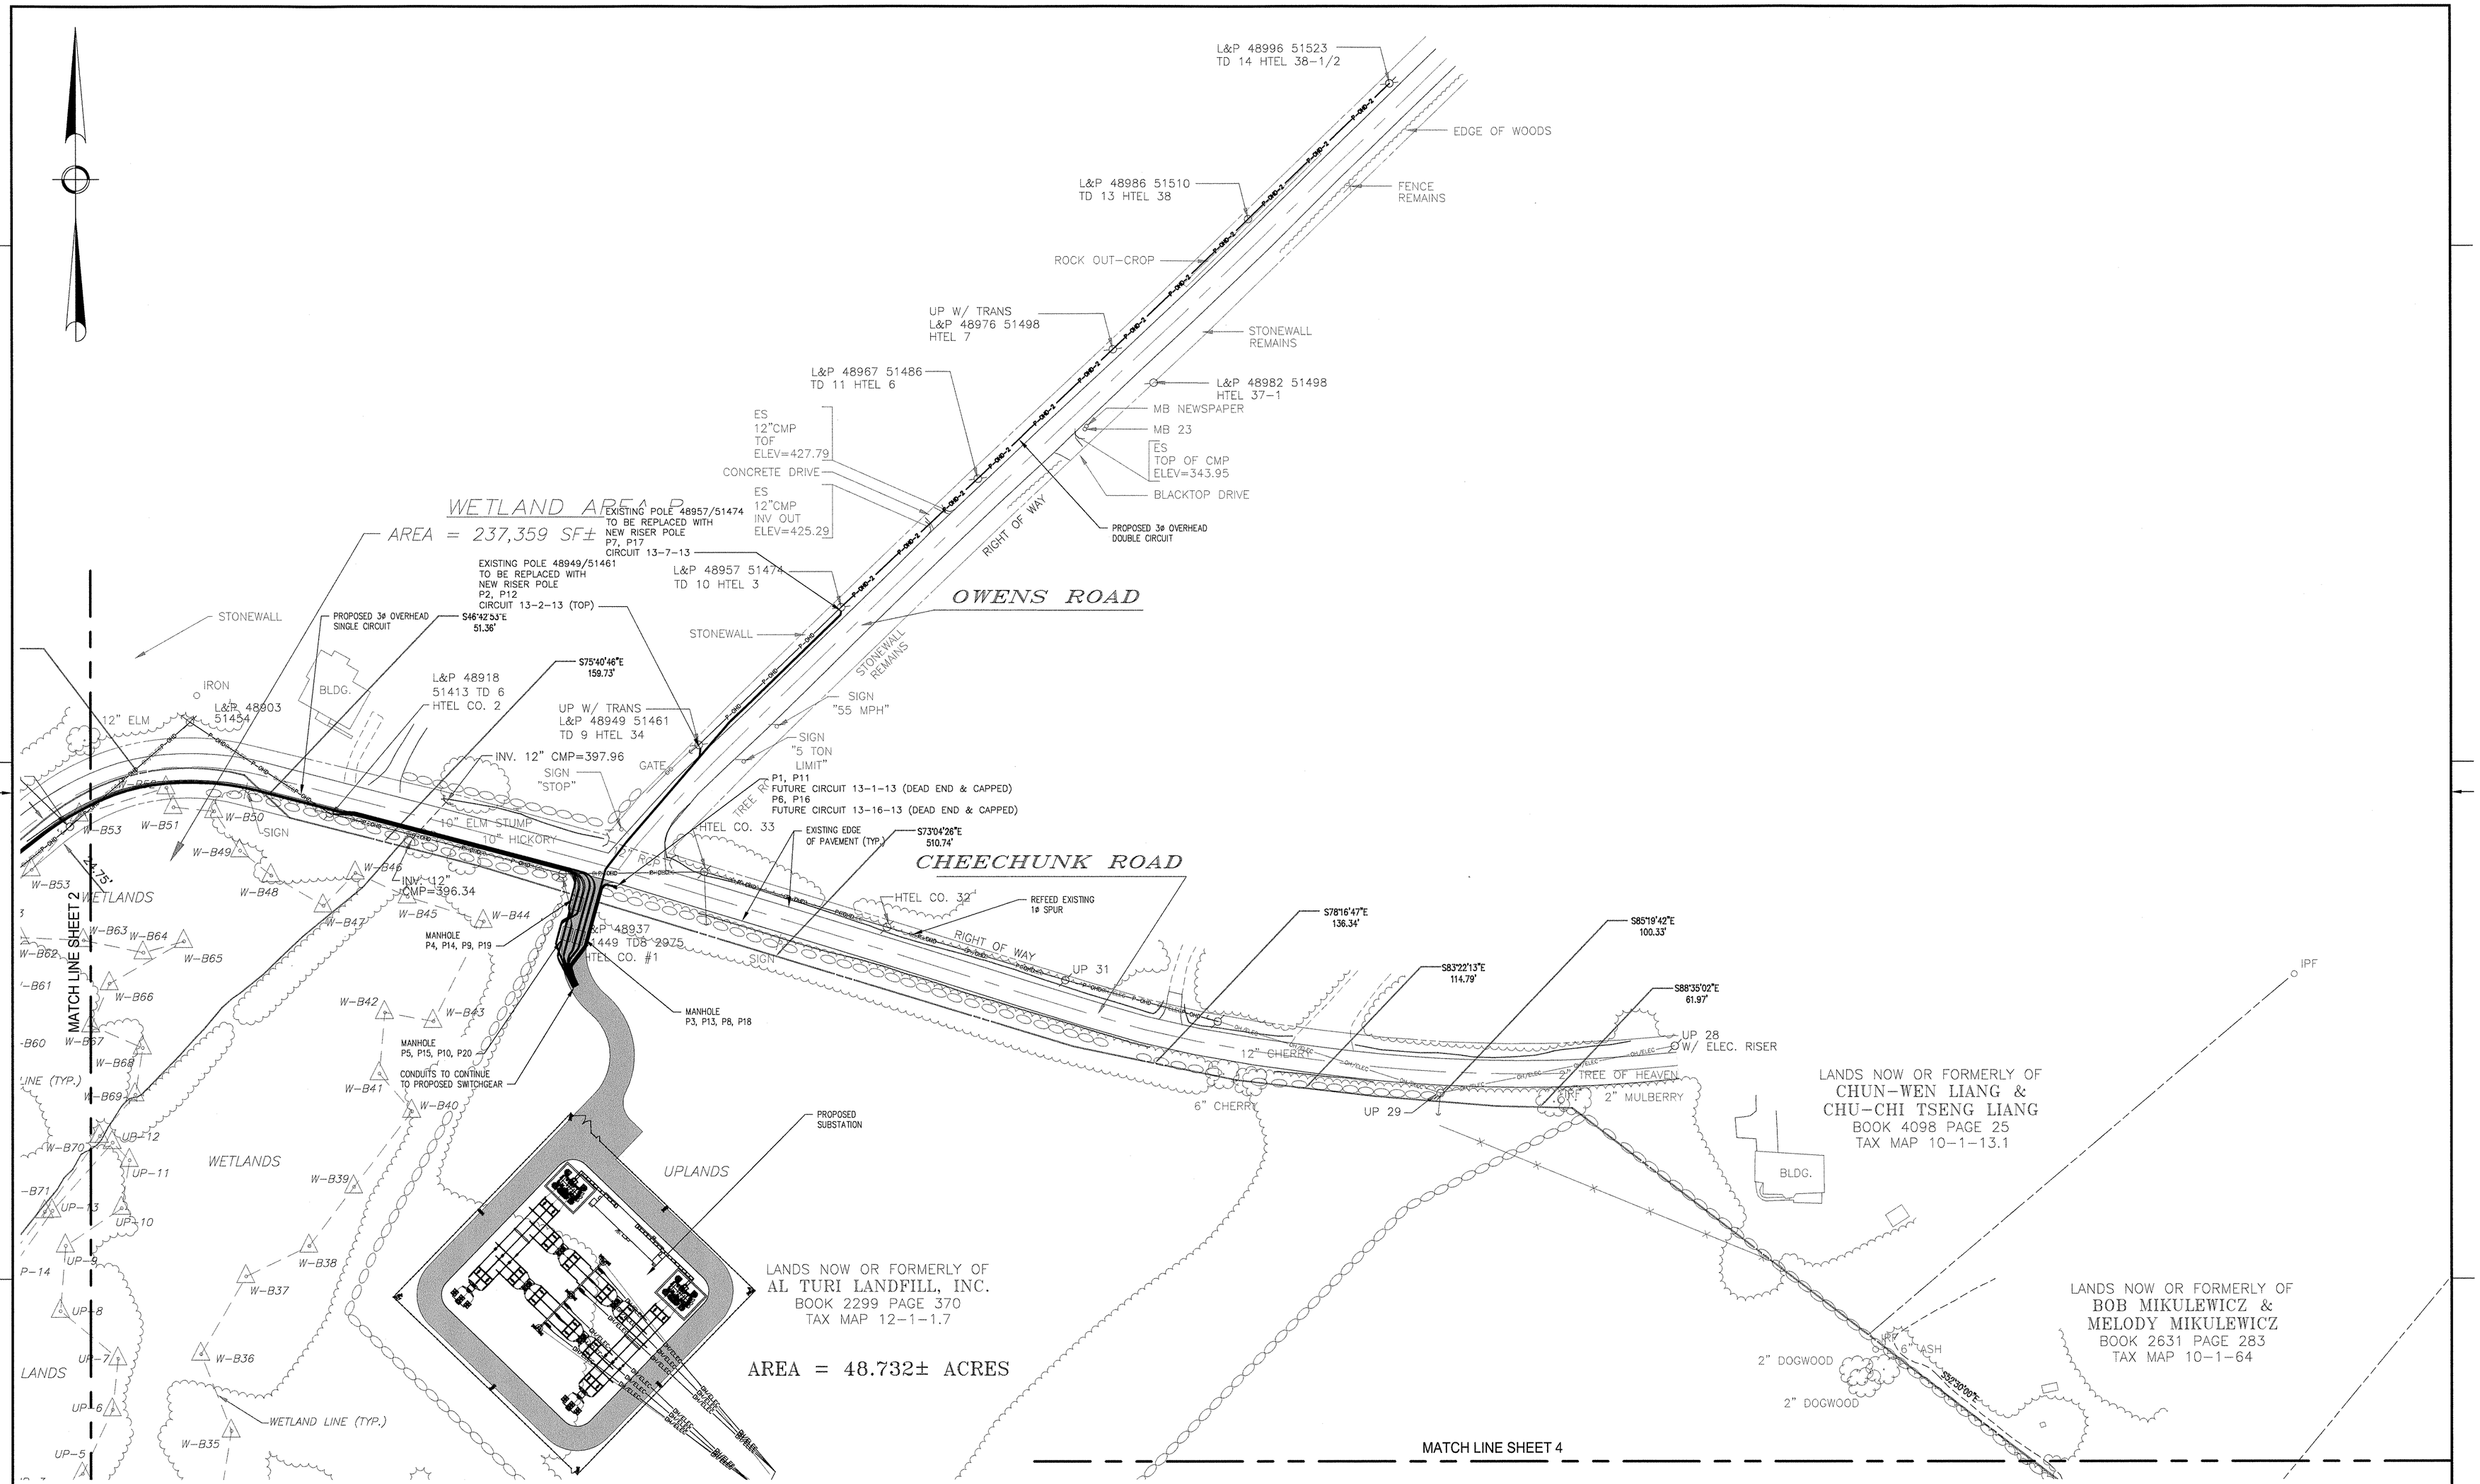

LEGEND

—P—CHD—P—CHD—	PROPOSED SINGLE CIRCUIT OVERHEAD DISTRIBUTION WIRE
—P—CHD—2—	PROPOSED DOUBLE CIRCUIT OVERHEAD DISTRIBUTION WIRES
—UD—UD—	PROPOSED UNDERGROUND DISTRIBUTION CONDUITS
	PROPOSED UTILITY POLE
—OH/ELEC—OH/ELEC—	EXISTING OVERHEAD ELECTRIC

0 1 2 3 ARCH
0 1 2 3 ENGRG

REV	REVISION	DWN	DES	CHKD	DATE

ORANGE AND ROCKLAND UTILITIES, INC.
PEARL RIVER NEW YORK

ENGINEERING REVIEW		
DEPT.	SIGNATURE	DATE
CIVIL/SURVEY		
TELECOM/MET.		
TRANS & SUB.		
RELAY		
DISTRIBUTION		5-2-12
DWN J.M.	DES	CHKD
DESIGN REVIEW		DATE 5-2-12

APPROVED DATE 5-2-12
☒ PERMIT
☐ BID
☐ CONSTRUCTION
☐ RECORD
☐

HARTLEY ROAD SUBSTATION

UNDERGROUND / OVERHEAD DISTRIBUTION IMPROVEMENTS SHEET 3

SCALE	STATION NO.	DRAWING NUMBER			SHEET	REV.
1" = 50'	0013	K	F	6500	4 OF 5	A

I:\Tedd_WORKREQ\CIVIL\Hartley\06017C\Hartley Road Substation - Al Turi Site - TB JMt_Environmental Package Drawings\K6500.dwg, 5/2/2012 2:: 05:59 PM